



3554 BATTERY HITESTER

Field Measuring Instruments



Get a Complete Diagnosis of UPS Batteries with a Single Device





The New Standard for Assessing **Deterioration of Lead-acid Batteries**


Repeated recharging of a secondary battery can lead to battery deterioration and increase its internal resistance. Problems can intensify when there is a short-circuit in the internal cell leading to voltage drop, overheating and complete battery malfunction. Worst of all, these problems can cause life-threatening fires and other accidents.








HANDS FREE Data Capture Allows You to Focus on the Testing

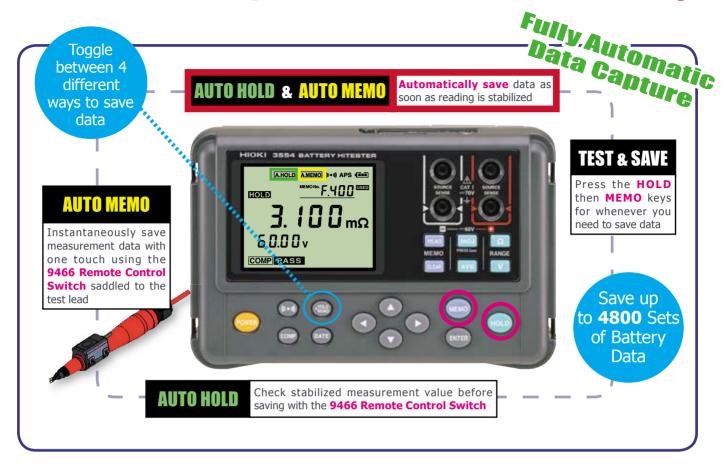

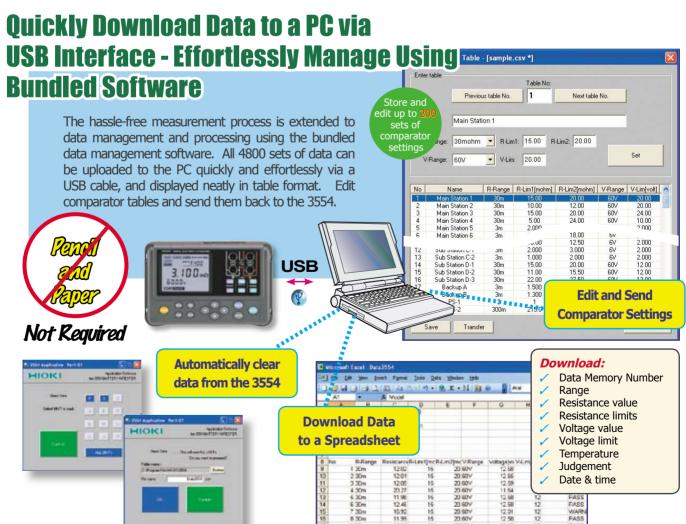

Tough Against Noise Plus Wide 60V Range

Trying to measure UPS backup batteries while they are still being used naturally brings about noise coming from the battery's inverter or rectifying circuit. The enhanced measurement current in the 3554 plus fortified circuit design, added with the Averaging Function to handle batteries that have fluctuating measurement values no matter how steady you hold the probe makes the battery tester extra resistant against the adverse effects of noise.



Three-rank rating of battery state: Pass. Warning or Fail

Assessment is based on a 6-way combination of comparisons against upper and lower resistance limits and a voltage threshold. Immediately see the judgement result on the bright LCD and beep on your choice of PASS or WARNING/FAIL.

	Resistance VOLTAGE	Low	In Range	High
Voltage	High	Pass	Warning	Fail
threshold value	Low	Warning	Warning	Fail

th

0 to 12V PC

vehicles: 48V DC

First resistance limit \(\Lambda\)

∧ Second resistance limit

Common battery cells: **10 Hours of** Fork lifts and electric Continuous **Operation**

Save time and money with an uninterrupted workflow

Wide Selection of Tough and



The Advantages of 4-Terminal Measurement

The Quality of Your Test Lead CAN Make a Difference


When measuring certain batteries such as leadacid cells, the resulting measurement value may differ depending on the test leads used to conduct the measurement. This difference is due to the shape of the probe tip as well as the dimensions of the 4-terminal test leads used for measurement. However, despite a difference in value given by different test leads, it is safe to assume that each specific value reflects the correct value obtainable by the respective

Based on this principle, when diagnosing battery deterioration in a time series, it is particularly important to use test leads having the same tip shape

and dimensions in order to maintain measurement

consistency.

The difference in the measurement values obtained by different test leads is a physical phenomenon caused by the difference in distance between the SOURCE and SENSE pins of the test leads. This is more significant when the battery terminal contains a resistance higher than the internal resistance of the battery under test. The figure on the right demonstrates how even minute physical differences between the SOURCE and SENSE pins for two types of test leads can affect the detected voltage level of the battery.



Specifications

Basic Specifications

Measurement items Resistance (AC four-terminal method) voltage

temperature (platinum temperature sensor, only when using 9460 leads)

Display LCD

> LCD All Segments Displayed

OADJ A.HOLD A.MEMO ((10)) APS AVG DATE MEMONO. 8.8.8.8 USED READ NO. 8.8.8.8 V -8.8.8.8 \$ 8.8.8.6 c COMP PASS WARNING FAIL

Sampling rate Once per second **Averaging Function** OFF. 4. 8. or 16 times Input overflow [OF] is displayed Constant current fault [----] is displayed detection

5 VMax

Open-circuit terminal voltage

Auto power off after 10 minutes unless during data Auto power off

Comparator Settings First and second resistance limits, and lower voltage limit

Number of Comparator : 200 Sets

Settings

LCD display of PASS, WARNING, or FAIL. Select **Comparator Output** beeper to sound on PASS/WARNING or FAIL. 0 to 40°C (32°F to 104°F), 80% rh or less (no condensation)

Operating temperature : and humidity Absolute maximum

60V DC, No AC input allowed

input voltage Withstand voltage

Between input terminals and output terminals (including EXT. HOLD/MEMO, and USB terminals): 1.5 kV AC rms

for 15 seconds

Maximum rated power

consumption

Continuous operating : 10 hours (using alkaline batteries)

Power supply AA (LR6) Alkaline Batteries x 8

2 VA

Dimensions and mass

: Approx.192W x 121H x 55D mm, 790 g (including batteries)

Model 9465-10 PIN TYPE LEAD x 1, USB cable x 1, Application Software CD x 1, Strap x 1, Carrying case x 1, Zero adjustment

board x 1, LR6 alkaline batteries x 8. Fuse x 1



Functions

(1) Pressing the HOLD key

(2) Inputting signals to the EXT.HOLD/MEMO terminal

(3) Stabilizing measured values (when the auto-hold feature is on)

Data Storage While the measured values are being held, pressing MEMO key

will save them to internal memory.

When the auto-memory feature is on, measured values will be

saved to the instrument's internal memory when held.

Saved items: Date, time, resistance value, voltage value, temperature, comparator setting values, and comparator

judgement. Maximum storable data: 4800 sets. Memory structure: 400 data sets per unit (12 units)

Reading data Read stored data on instrument or with PC application USB

PC Interface

PC Software Application

Windows compatible, using USB interface

PC to 3554; transfer comparator tables edited on Excel. delete data from 3554, initialize the 3554, make clock settings.

3554 to PC: transfer data stored in memory (save files on PC in

CSV format)

Measurement Accuracy (Guaranteed Accuracy Period: 1 Year)

: 23°C± 5°C (73°F± 9°F), non-condensating, after zero-Guaranteed Accuracy Conditions adjustment, warm-up time not required

Resistance Measurement

Temperature coefficient : ±0.01 %rdg.±0.8 dgt./°C Measurement current frequency : 1 kHz±30 Hz

Measurement current reliability: ±10 %

Range	Max. display	Resolution	Measurement Current	Accuracy
$3\text{m}\Omega$	3.100 mΩ	1μΩ	150 mA	±1.0 %rdg.±8 dgt.
$30~\text{m}\Omega$	31.00mΩ	10μΩ	150 mA	
300 mΩ	310.0 mΩ	100μΩ	15 mA	±0.8 %rdg.±6 dgt.
3 Ω	3.100 Ω	1 mΩ	1.5 mA	

Voltage Measurement

Temperature coefficient : ±0.005 %rdg.±0.5 dgt./°C

Range	Max. display	Resolution	Accuracy	
6 V	±6.000 V	1 mV	±0.08 %rdg.±6 dgt.	
60 V	±60.00 V	10 mV		

Temperature Measurement

Measurement Range	Resolution	Accuracy
10°C to 60°C	0.1°C	±1.0°C

To Our Valued Customers

The thresholds for determining the pass/fail condition of a battery depends on the specifications and standards of the battery manufacturer, battery type, capacity, etc. It is important and necessary to always conduct battery testing against the internal resistance and terminal voltage of a new or reference battery. In some cases, it may be difficult to determine the deterioration state of sealed lead acid batteries which demonstrates smaller changes in internal resistance than traditional open type (liquid) lead-acid or alkaline batteries.

Options

Bundled with the standard 3554

9465-10 Pin-type Lead

9454 Zero Adjustment Board

9460 Clip-type Lead with Temperature Sensor

9772 Pin-type Lead

9466 Remote Control Switch

9467 Large Clip Type Lead (no CE mark)

9465-90 Tip Pin (to replace the tip on Model 9465-10)

9772-90 Tip Pin (to replace the tip on Model 9772)

HIOKI E.E. CORPORATION

HEAD OFFICE:

81 Koizumi, Ueda, Nagano, 386-1192, Japan TEL +81-268-28-0562 / FAX +81-268-28-0568 E-mail: os-com@hioki.co.jp

HIOKI USA CORPORATION:

6 Corporate Drive, Cranbury, NJ 08512 USA TEL +1-609-409-9109 / FAX +1-609-409-9108

F-mail: hioki@hiokiusa.com

Shanghai Representative Office:

Snangnal Representative Office: 1310 Shanghai Times Square Office: 93 Huaihai Zhong Road Shanghai, 200021, P.R.China TEL +86-21-6391-0090, 0092 FAX +86-21-6391-0360 E-mail: info@hioki.cn

DISTRIBUTED BY

지율근시 서울특별시 영등포구 경인로 775(문래동 3가, 에이스하이테크시티 3동 201호) TEL: 070-7872-0701 FAX: 02-2167-3801 E-mail: sales@nubicom.co.kr

고객지원센터 TEL: 070-7872-0701, 080-801-7880 FAX: 02-2167-3802 E-mail: oft@nubicom.co.kr

대전 사구도 대전광역시 유성구 대덕대로 593(도룡동 386-2) 대덕테크비즈센터 203호 TEL: 070-7872-0712 FAX: 042-863-2023 E-mail: inyeom@nubicom.co.kr